


# Average costs for the operation of an electric boiler in comparison to a gas-fired CHP system for the years 2025, 2030 and 2035 with increasing full-load hours

Figure 12

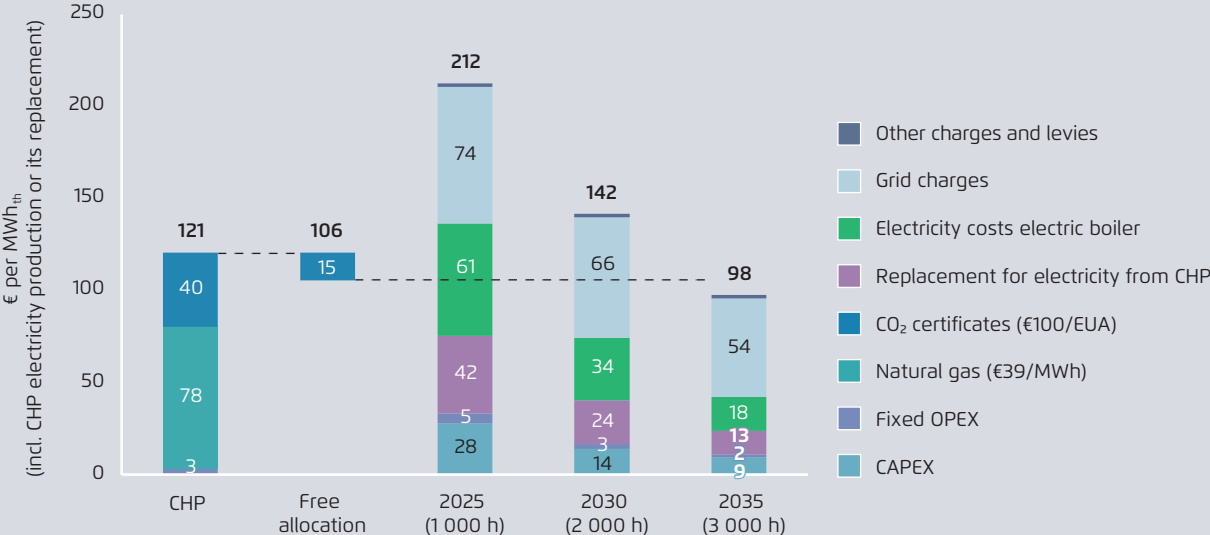

Electricity prices as in *Climate Neutral Power System 2035* reflecting full-load hours (Agora Energiewende, Prognos, Consentec 2022); grid charges as applied by grid operator Westnetz in 2021 (Agora Energiewende 2021)

Agora Industry, FutureCamp (2022)